


# HISTORICAL WATER DISTRIBUTION SYSTEM LEAD SAMPLING

2017 - 2023

Location ID	2017	2020	2023
1	NS	ND	ND
2	ND	ND	ND
3	0.002 mg/L	ND	ND
4	ND	ND	ND
5	ND	ND	ND
6	ND	NS	NS
7	NS	ND	ND
8	NS	ND	ND
9	ND	NS	NS
10	ND	NS	NS
11	ND	ND	ND
12	NS	0.005 mg/L	ND
13	ND	ND	ND
14	ND	ND	ND
15	ND	ND	ND
16	ND	NS	NS
17	NS	0.12 mg/L	NS
18	ND	ND	ND
19	NS	ND	ND
20	ND	NS	ND
21	ND	ND	ND
22	ND	NS	NS
23	ND	NS	NS
24	NS	ND	ND
25	NS	ND	ND
26	ND	NS	NS
27	NS	NS	ND
28	ND	NS	NS
29	ND	NS	NS
30	NS	NS	ND
31	0.0026 mg/L	ND	ND
32	ND	NS	ND
33	ND	ND	ND
34	ND	NS	NS
35	NS	NS	ND
36	0.24 mg/L	NS	NS
37	ND	NS	NS
38	ND	NS	NS
39	0.0039 mg/L	ND	ND
40	ND	NS	NS
41	ND	ND	ND
42	ND	NS	NS
43	ND	ND	ND
44	NS	NS	ND
45	NS	ND	ND
46	ND	NS	NS
47	ND	ND	ND
48	NS	ND	ND
49	ND	NS	NS
50	NS	ND	ND
51	NS	ND	NS
52	NS	ND	ND
53	NS	NS	ND
54	NS	ND	ND
55	NS	ND	ND
56	NS	NS	0.0051 mg/L
57	NS	ND	ND
58	NS	ND	ND
59	NS	ND	NS
60	NS	NS	ND

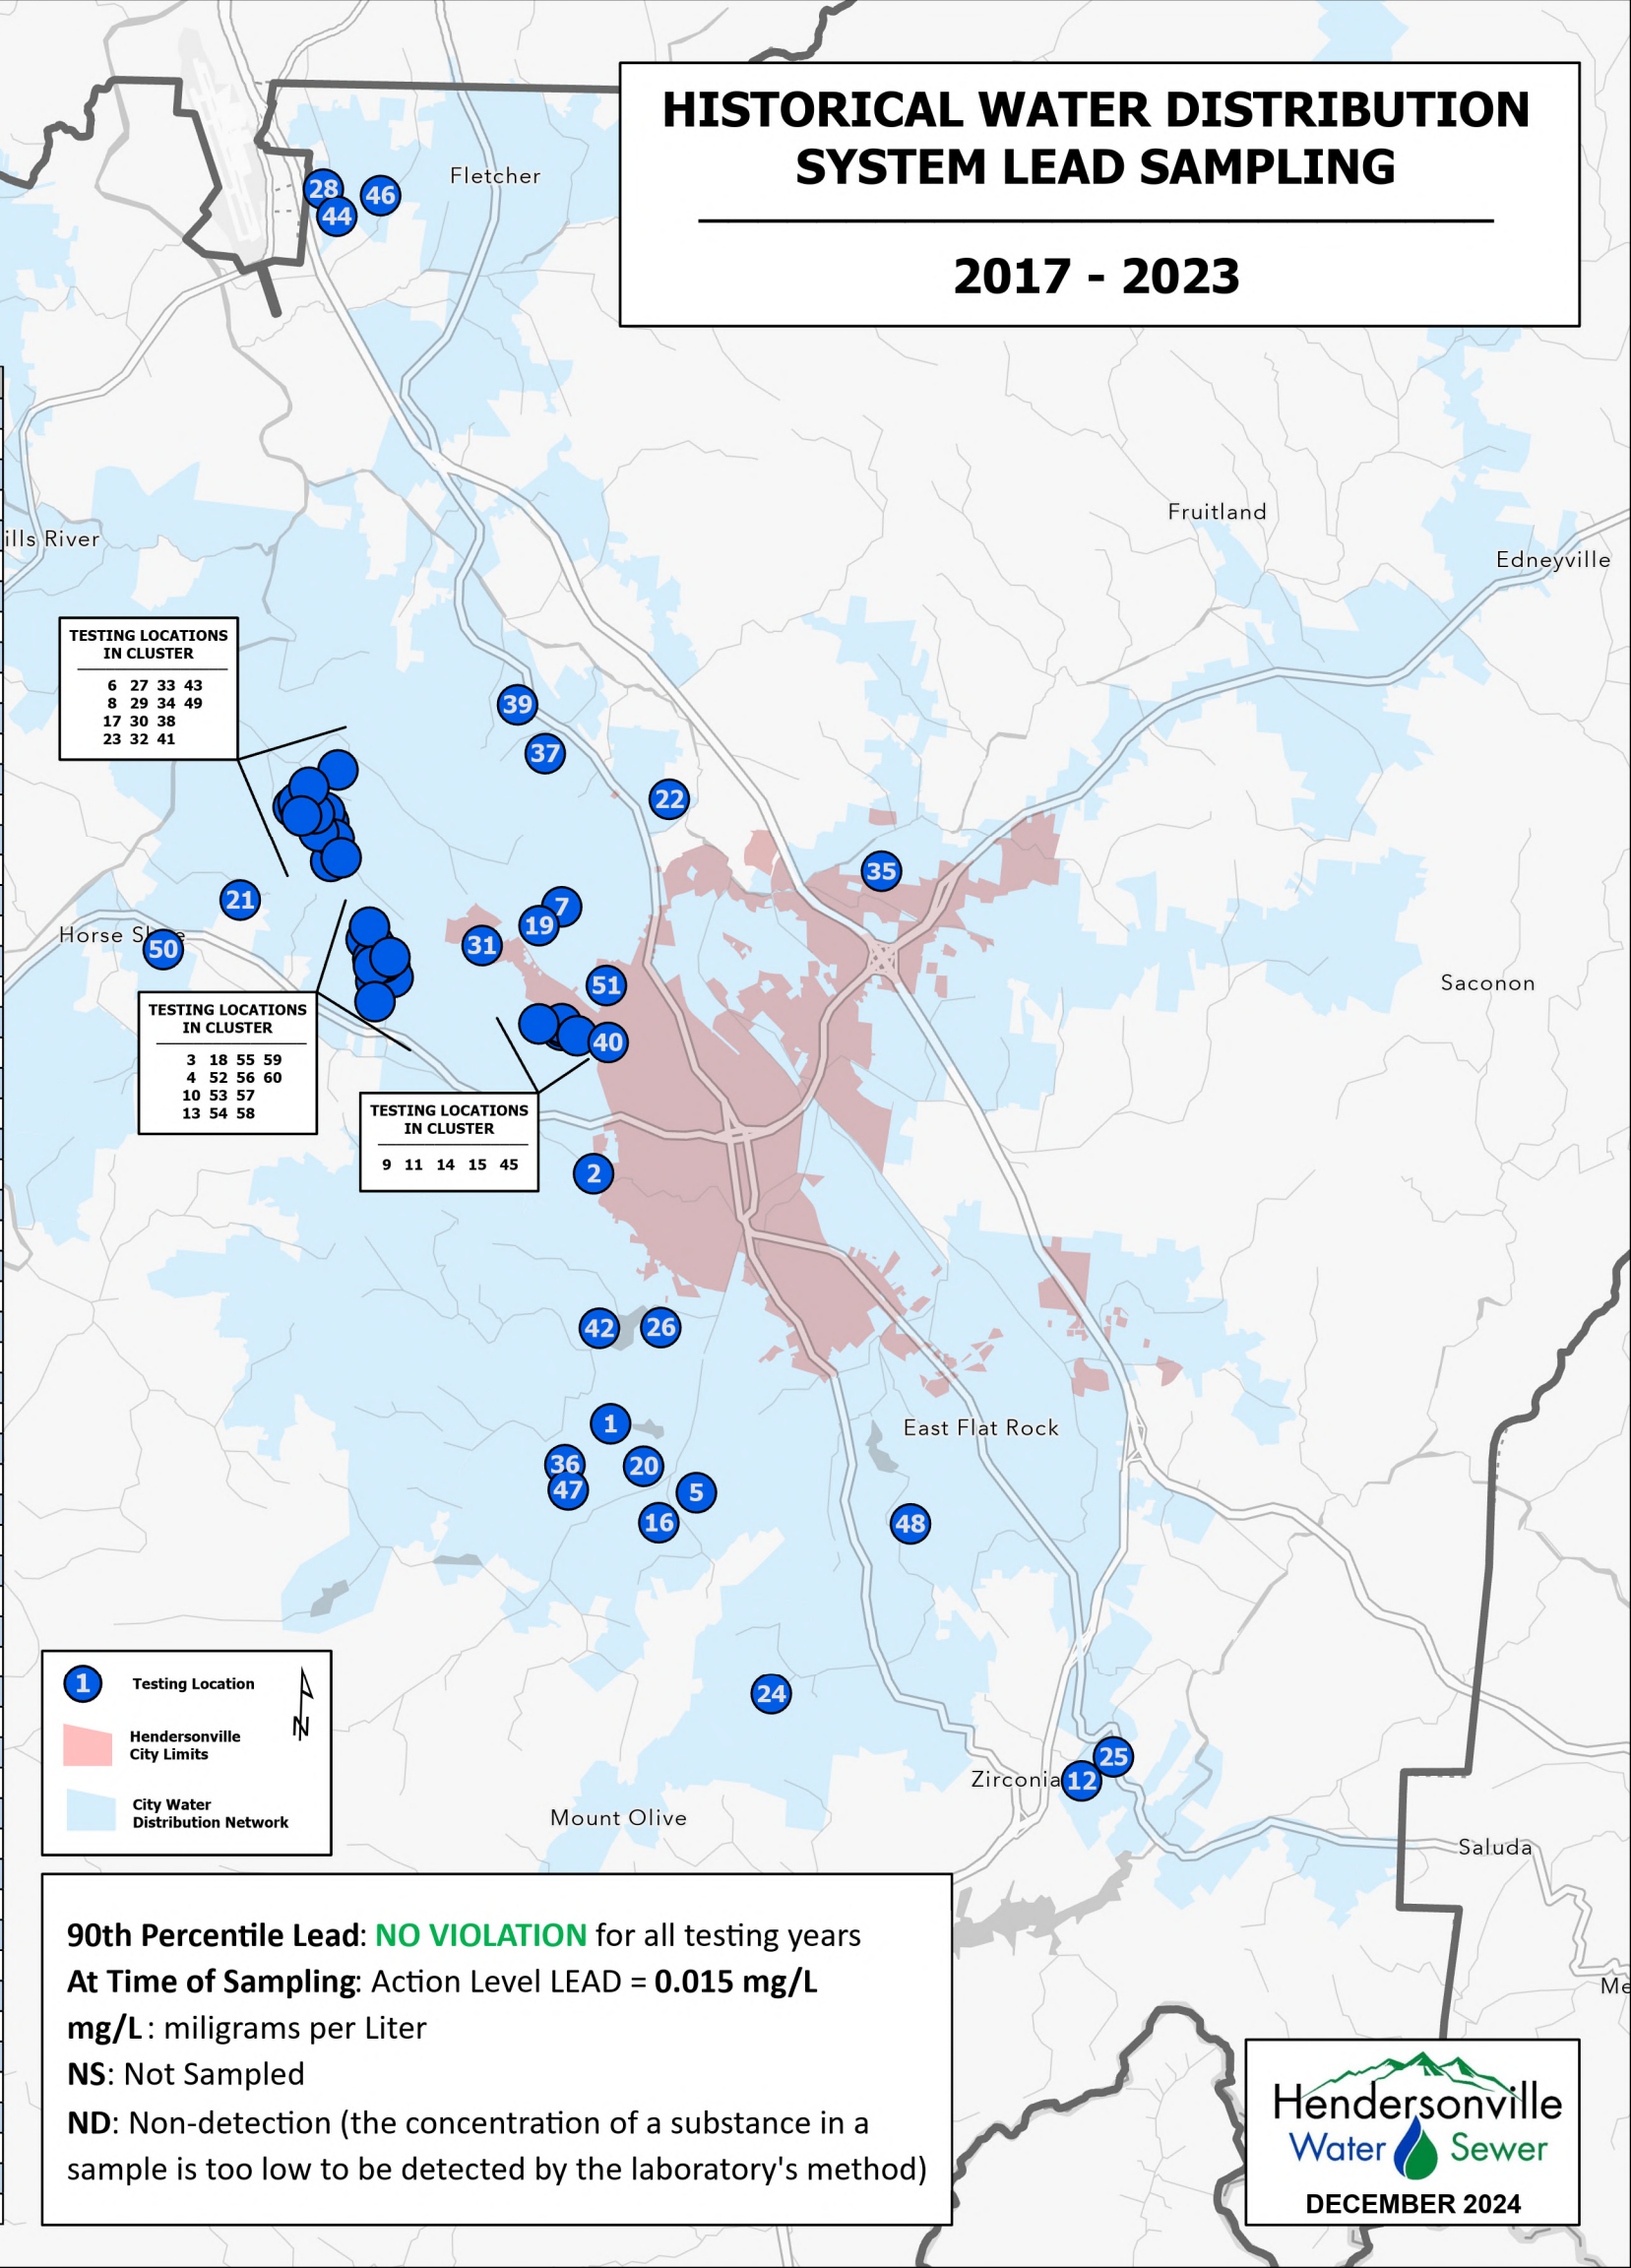

TESTING LOCATIONS IN CLUSTER  
6 27 33 43  
8 29 34 49  
17 30 38  
23 32 41

TESTING LOCATIONS IN CLUSTER  
3 18 55 59  
4 52 56 60  
10 53 57  
13 54 58

TESTING LOCATIONS IN CLUSTER  
9 11 14 15 45

1 Testing Location

Hendersonville City Limits

City Water Distribution Network

**90th Percentile Lead: NO VIOLATION** for all testing years  
**At Time of Sampling: Action Level LEAD = 0.015 mg/L**  
 mg/L : milligrams per Liter  
**NS:** Not Sampled  
**ND:** Non-detection (the concentration of a substance in a sample is too low to be detected by the laboratory's method)